Figures

Document ID: 0901d196805d2e1d

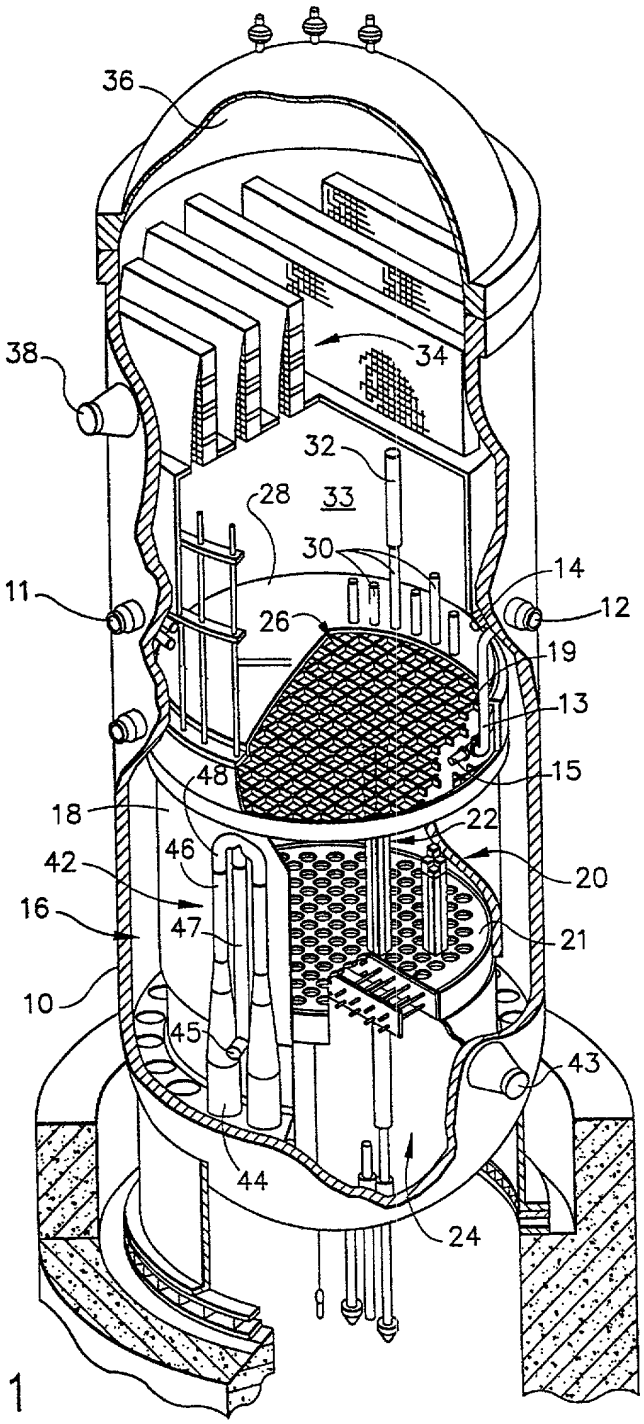

FIG. 1

Petitioner's Exhibit 1005 - Page 29 of 30

FIGURE 2

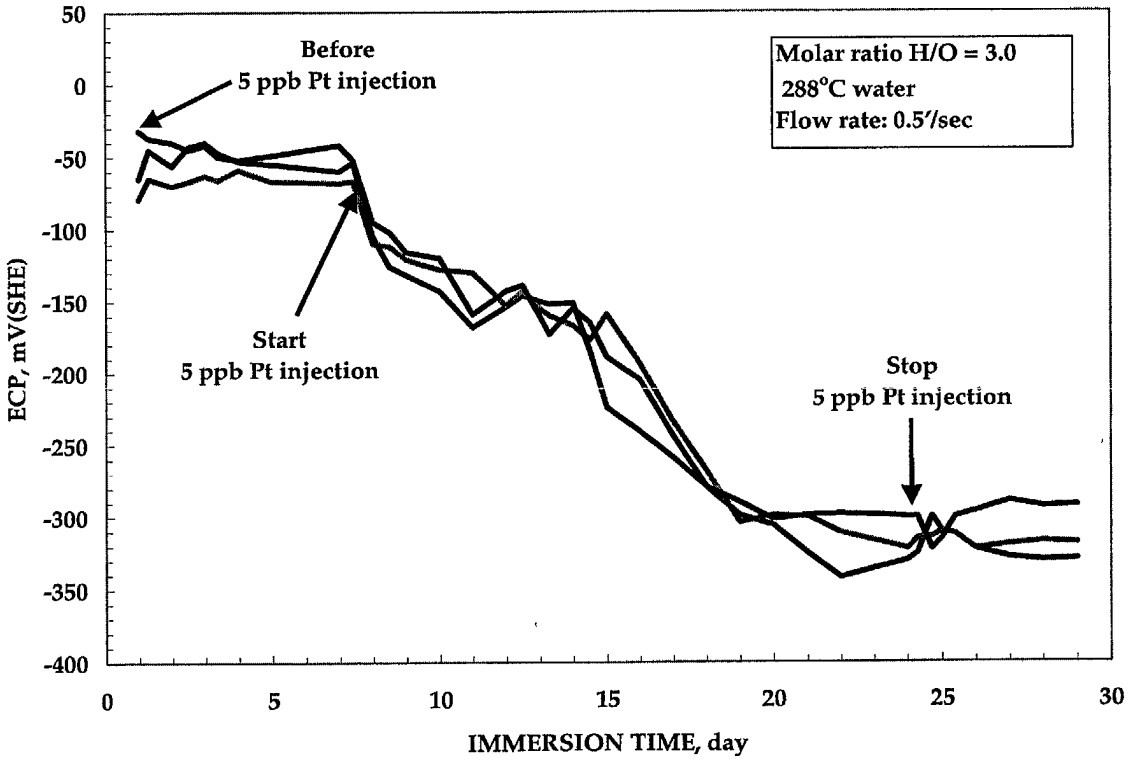
Before
5 ppb Pt injection
Molar ratio H/O = 3.0
288°C water
Flow rate: 0.5'/sec
Start
5 ppb Pt injection
Stop
5 ppb Pt injection
ECP, mV(SHE)
IMMERSION TIME, day
50
0
-50
-100
-150
-200
-250
-300
-350
-400
0
5
10
15
20
25
30